


Color Difference Report

Specimen Information		
	Standard	Sample
Name	Prin***U	PCnoir®81
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/7/2026 1:40:03 PM	4/7/2026 1:53:56 PM

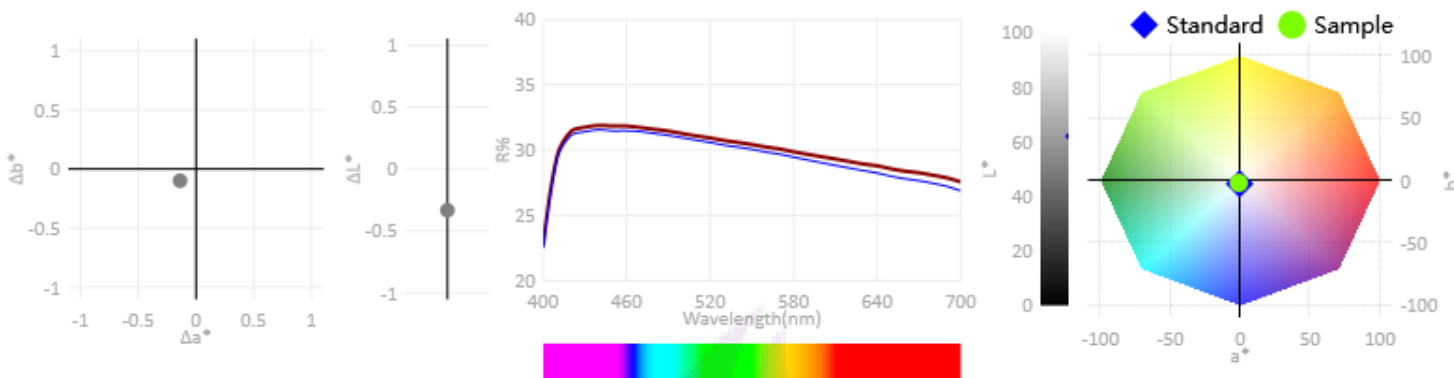

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	61.97	-1.19	-1.83	--	51.75
	Sample	61.64	-1.33	-1.93	102.68	52.31
A/2°	Standard	61.67	-1.65	-2.37	--	52.27
	Sample	61.31	-1.84	-2.51	102.68	52.87
F2/2°	Standard	61.78	-0.69	-2.25	--	52.08
	Sample	61.43	-0.78	-2.37	102.68	52.66

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-0.33	-0.14	-0.10	0.37	Pass
A/2°	-0.36	-0.19	-0.14	0.43	Pass
F2/2°	-0.35	-0.10	-0.12	0.38	Pass

Test: Alfred Audit: Karry

Instrument Model: X-rite Ci64