


## Color Difference Report

Specimen Information		
	Standard	Sample
Name	Prin***U	PCnoir®5327
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/7/2026 1:40:03 PM	4/7/2026 1:47:13 PM

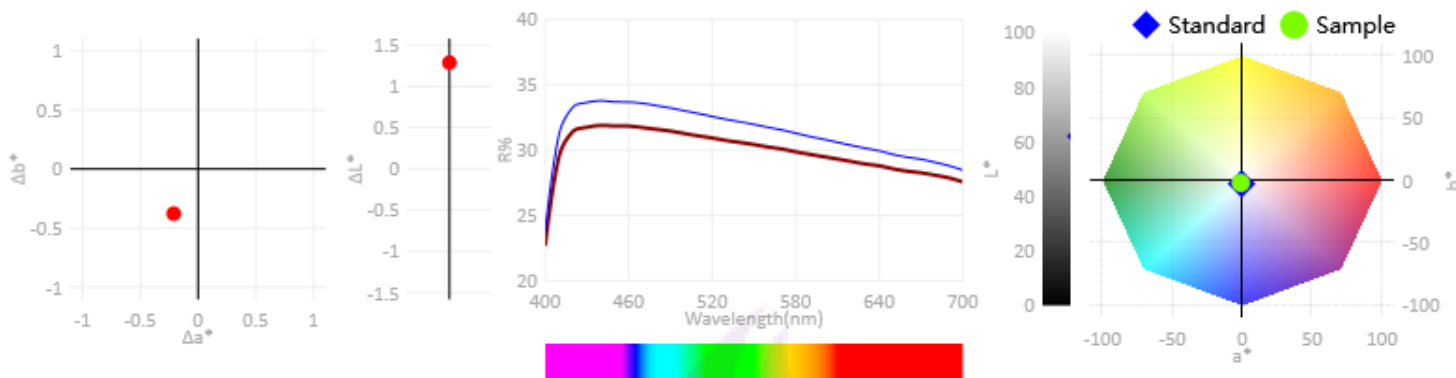

### Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	61.97	-1.19	-1.83	--	51.75
	Sample	63.26	-1.40	-2.20	91.59	49.62
A/2°	Standard	61.67	-1.65	-2.37	--	52.27
	Sample	62.89	-1.98	-2.83	91.59	50.22
F2/2°	Standard	61.78	-0.69	-2.25	--	52.08
	Sample	63.03	-0.81	-2.70	91.59	50.01

### Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	1.29	-0.21	-0.38	1.36	Fail
A/2°	1.23	-0.32	-0.46	1.35	Fail
F2/2°	1.25	-0.12	-0.45	1.34	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64