


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®5319
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:28:43 AM	4/10/2026 9:31:30 AM

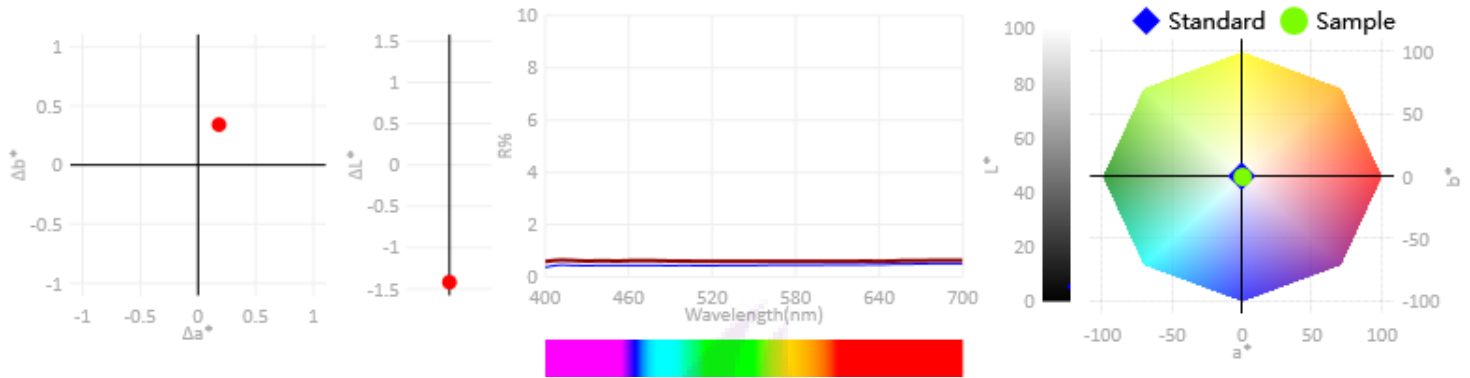

### Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	5.44	0.08	-0.23	--	221.99
	Sample	4.03	0.26	0.12	135.61	235.10
A/2°	Standard	5.44	0.07	-0.22	--	222.06
	Sample	4.07	0.33	0.20	135.61	234.63
F2/2°	Standard	5.43	0.07	-0.24	--	222.12
	Sample	4.04	0.17	0.16	135.61	234.90

### Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.42	0.18	0.34	1.47	Fail
A/2°	-1.37	0.26	0.41	1.45	Fail
F2/2°	-1.38	0.10	0.40	1.44	Fail

Test: Alfred      Audit: Karry

Instrument Model: X-rite Ci64