


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®5319
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:19:33 AM	4/10/2026 9:24:45 AM

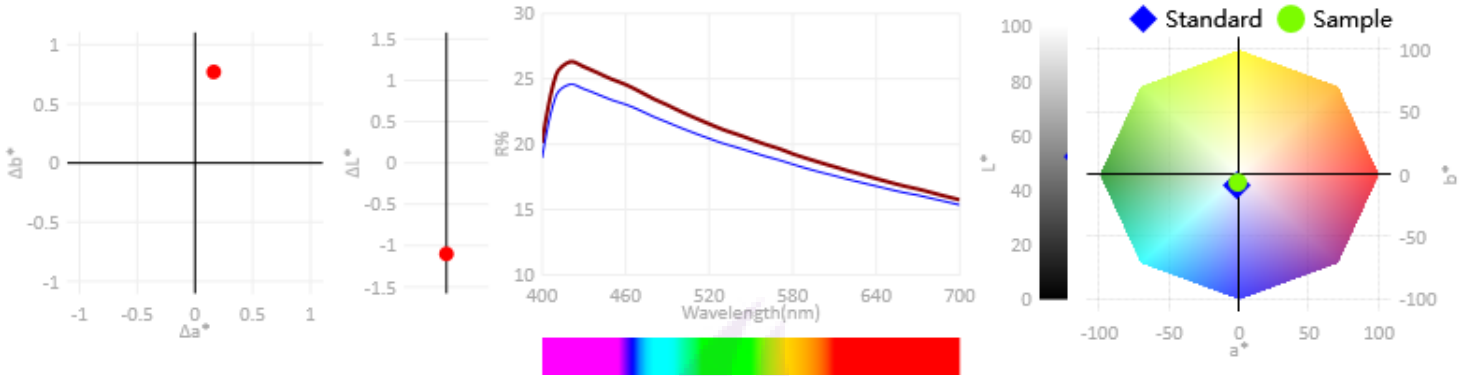

**Tolerance**

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

**Color Indexes**

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	52.36	-1.68	-7.74	--	68.90
	Sample	51.26	-1.51	-6.97	107.00	71.02
A/2°	Standard	51.43	-3.89	-8.64	--	70.67
	Sample	50.43	-3.49	-7.77	107.00	72.63
F2/2°	Standard	51.70	-0.69	-9.03	--	70.17
	Sample	50.67	-0.63	-8.12	107.00	72.17

**Color Diff.**

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.10	0.16	0.77	1.35	Fail
A/2°	-1.01	0.40	0.87	1.39	Fail
F2/2°	-1.03	0.06	0.91	1.37	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64