


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	Prin***U	PCnoir®3200
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/7/2026 1:40:03 PM	4/7/2026 1:47:46 PM

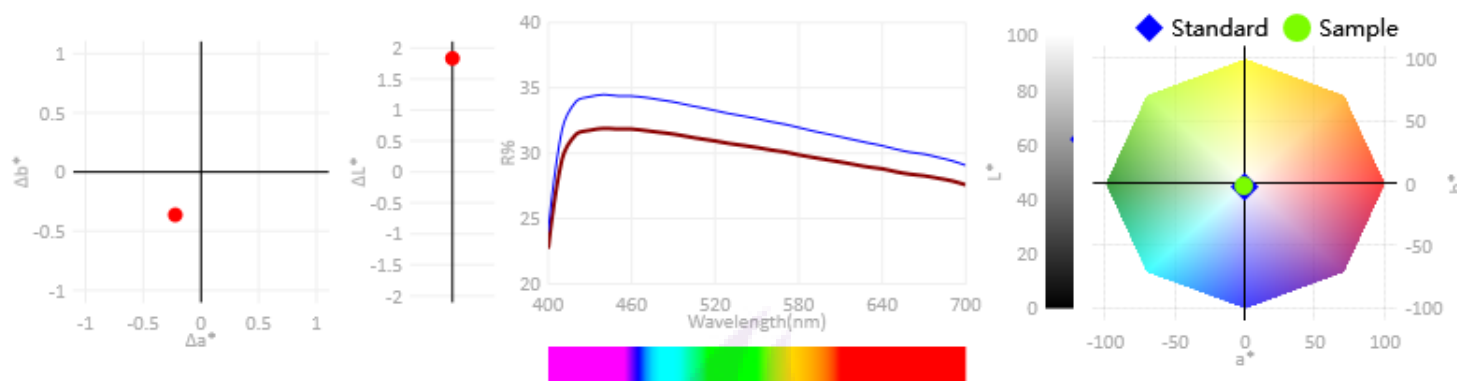

### Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	61.97	-1.19	-1.83	--	51.75
	Sample	63.81	-1.41	-2.19	88.13	48.72
A/2°	Standard	61.67	-1.65	-2.37	--	52.27
	Sample	63.44	-1.98	-2.83	88.13	49.33
F2/2°	Standard	61.78	-0.69	-2.25	--	52.08
	Sample	63.57	-0.82	-2.69	88.13	49.11

### Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	1.83	-0.22	-0.36	1.88	Fail
A/2°	1.77	-0.33	-0.45	1.86	Fail
F2/2°	1.80	-0.13	-0.44	1.85	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64