


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®3200
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:28:43 AM	4/10/2026 9:34:03 AM

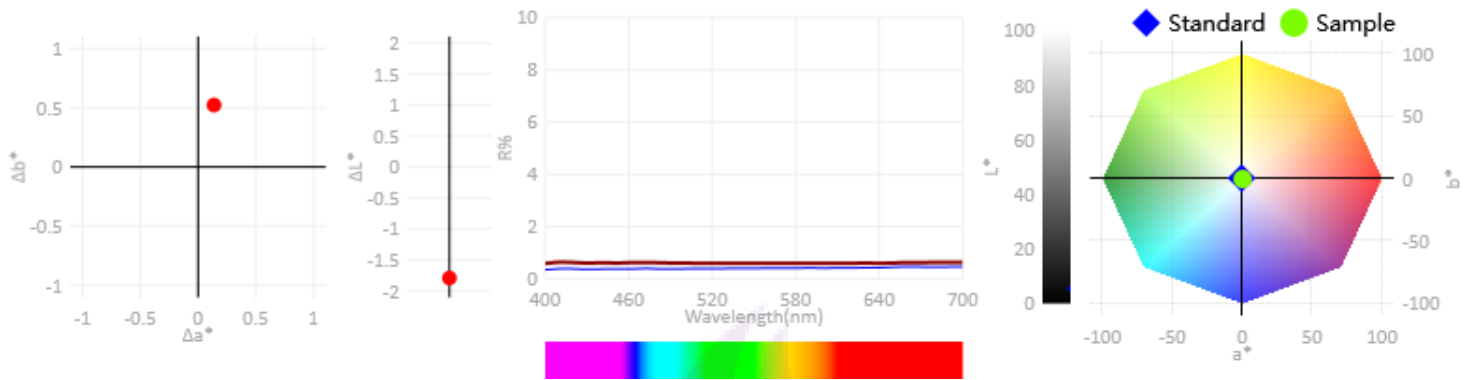

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	5.44	0.08	-0.23	--	221.99
	Sample	3.65	0.22	0.30	150.41	239.34
A/2°	Standard	5.44	0.07	-0.22	--	222.06
	Sample	3.71	0.32	0.38	150.41	238.69
F2/2°	Standard	5.43	0.07	-0.24	--	222.12
	Sample	3.68	0.11	0.40	150.41	238.98

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.79	0.14	0.52	1.87	Fail
A/2°	-1.73	0.25	0.59	1.85	Fail
F2/2°	-1.75	0.04	0.64	1.86	Fail

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64