


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®3200
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:19:33 AM	4/10/2026 9:25:45 AM

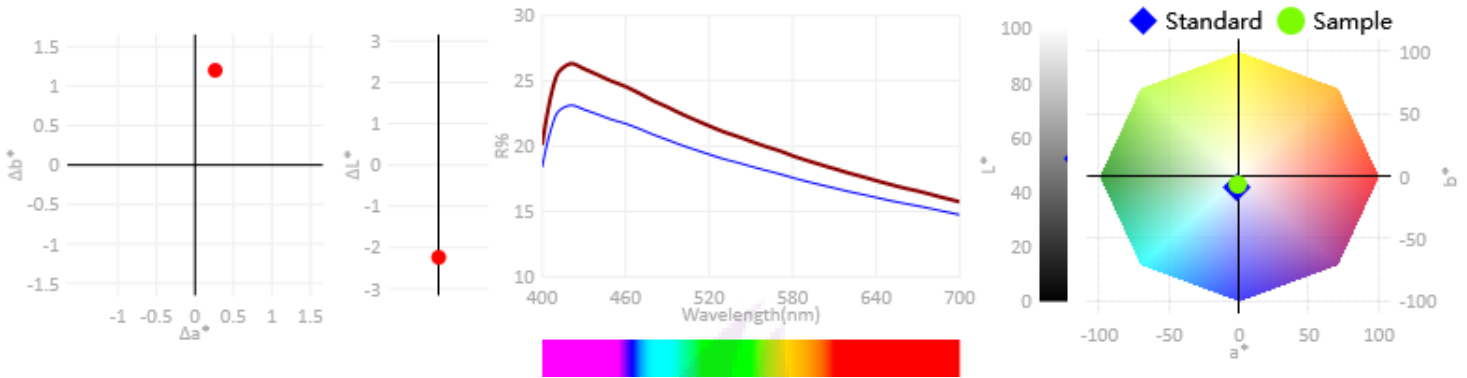

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	52.36	-1.68	-7.74	--	68.90
	Sample	50.12	-1.41	-6.54	114.92	73.23
A/2°	Standard	51.43	-3.89	-8.64	--	70.67
	Sample	49.35	-3.27	-7.28	114.92	74.77
F2/2°	Standard	51.70	-0.69	-9.03	--	70.17
	Sample	49.57	-0.59	-7.62	114.92	74.33

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-2.24	0.26	1.20	2.55	Fail
A/2°	-2.09	0.62	1.36	2.57	Fail
F2/2°	-2.13	0.10	1.41	2.55	Fail

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64