


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	Teknoir®i5
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:28:43 AM	4/10/2026 9:34:32 AM

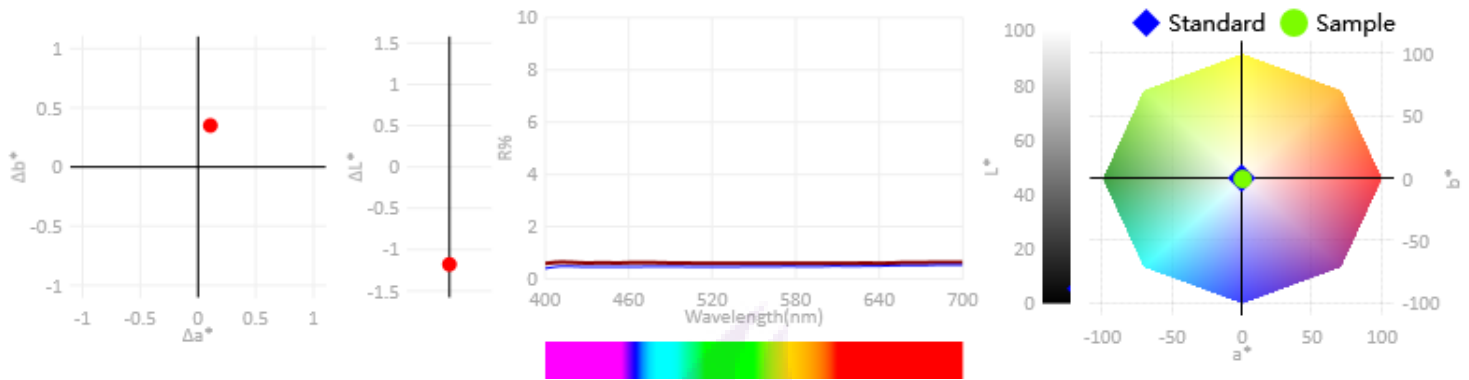

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	5.44	0.08	-0.23	--	221.99
	Sample	4.27	0.18	0.12	128.12	232.59
A/2°	Standard	5.44	0.07	-0.22	--	222.06
	Sample	4.30	0.26	0.18	128.12	232.24
F2/2°	Standard	5.43	0.07	-0.24	--	222.12
	Sample	4.28	0.11	0.18	128.12	232.41

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.18	0.11	0.35	1.23	Fail
A/2°	-1.14	0.19	0.40	1.22	Fail
F2/2°	-1.15	0.04	0.42	1.22	Fail

Test: Alfred Audit: Kamy
 Instrument Model: X-rite Ci64