


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®4510
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:28:43 AM	4/10/2026 9:33:33 AM

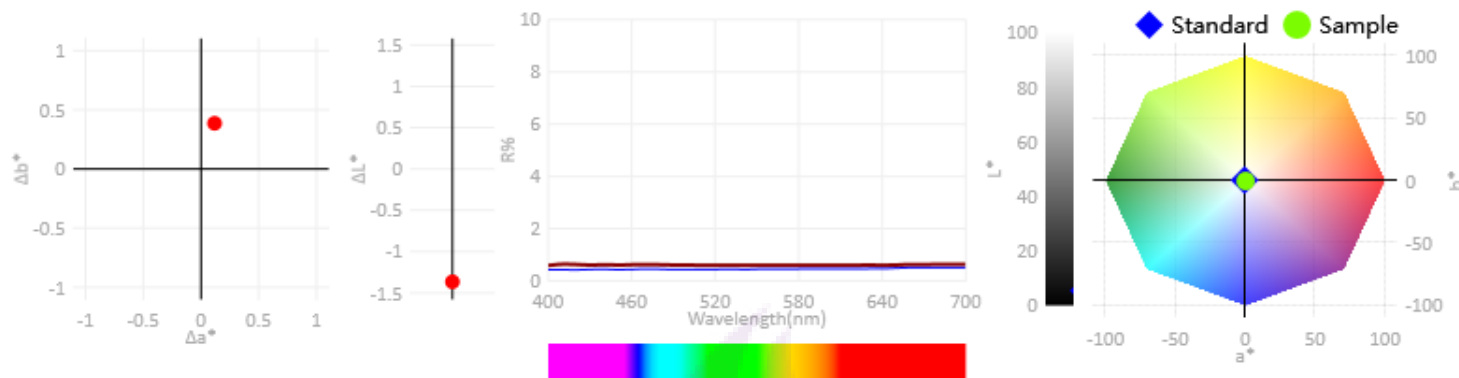

### Tolerance

	$\Delta E^*_{ab}$
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	5.44	0.08	-0.23	--	221.99
	Sample	4.08	0.20	0.16	133.84	234.53
A/2°	Standard	5.44	0.07	-0.22	--	222.06
	Sample	4.12	0.29	0.20	133.84	234.12
F2/2°	Standard	5.43	0.07	-0.24	--	222.12
	Sample	4.10	0.16	0.14	133.84	234.33

### Color Diff.

	$\Delta L^*$	$\Delta a^*$	$\Delta b^*$	$\Delta E^*_{ab}$	Judgement
D65/10°	-1.37	0.12	0.39	1.42	Fail
A/2°	-1.32	0.22	0.42	1.40	Fail
F2/2°	-1.33	0.09	0.38	1.39	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64