


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®4510
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:19:33 AM	4/10/2026 9:26:28 AM

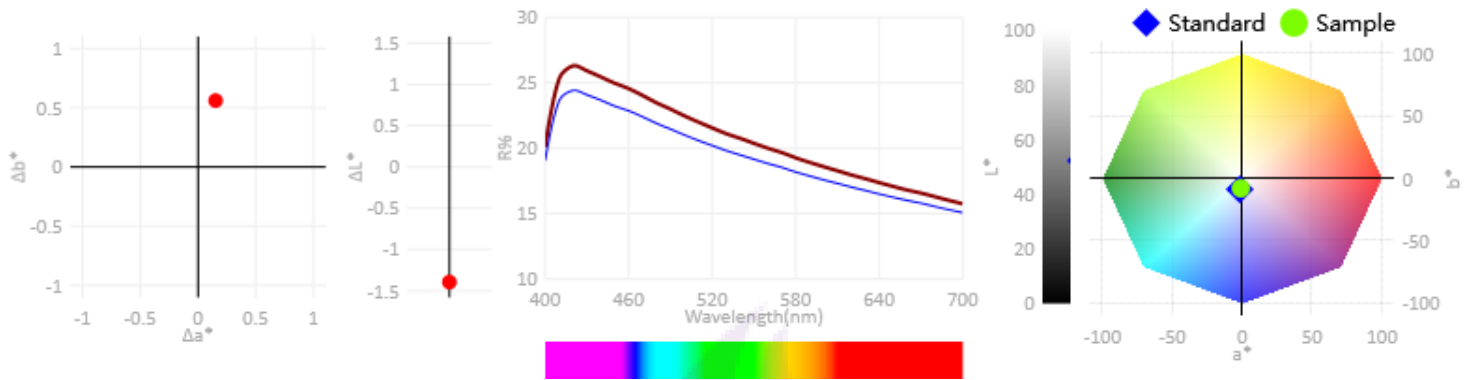

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	52.36	-1.68	-7.74	--	68.90
	Sample	50.96	-1.52	-7.18	109.09	71.58
A/2°	Standard	51.43	-3.89	-8.64	--	70.67
	Sample	50.12	-3.57	-7.99	109.09	73.25
F2/2°	Standard	51.70	-0.69	-9.03	--	70.17
	Sample	50.36	-0.62	-8.37	109.09	72.77

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.39	0.15	0.56	1.51	Fail
A/2°	-1.32	0.33	0.65	1.51	Fail
F2/2°	-1.34	0.07	0.66	1.50	Fail

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64