


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®6315
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:19:33 AM	4/10/2026 9:24:17 AM

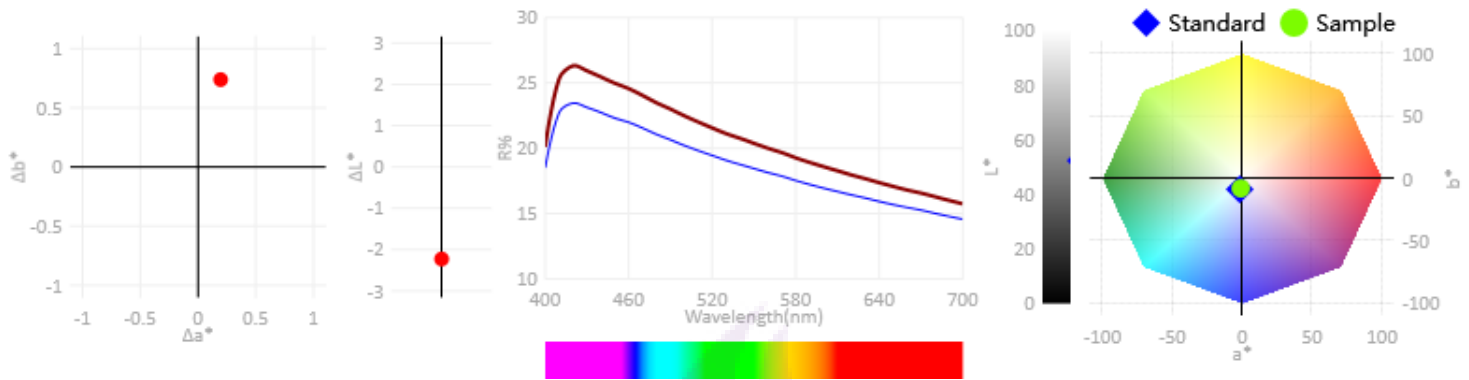

### Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	52.36	-1.68	-7.74	--	68.90
	Sample	50.13	-1.48	-7.01	115.08	73.22
A/2°	Standard	51.43	-3.89	-8.64	--	70.67
	Sample	49.30	-3.47	-7.79	115.08	74.86
F2/2°	Standard	51.70	-0.69	-9.03	--	70.17
	Sample	49.54	-0.60	-8.16	115.08	74.39

### Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-2.23	0.20	0.74	2.36	Fail
A/2°	-2.13	0.42	0.85	2.33	Fail
F2/2°	-2.16	0.09	0.87	2.33	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64