


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®71	PCnoir®85
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/10/2026 9:19:33 AM	4/10/2026 9:20:46 AM

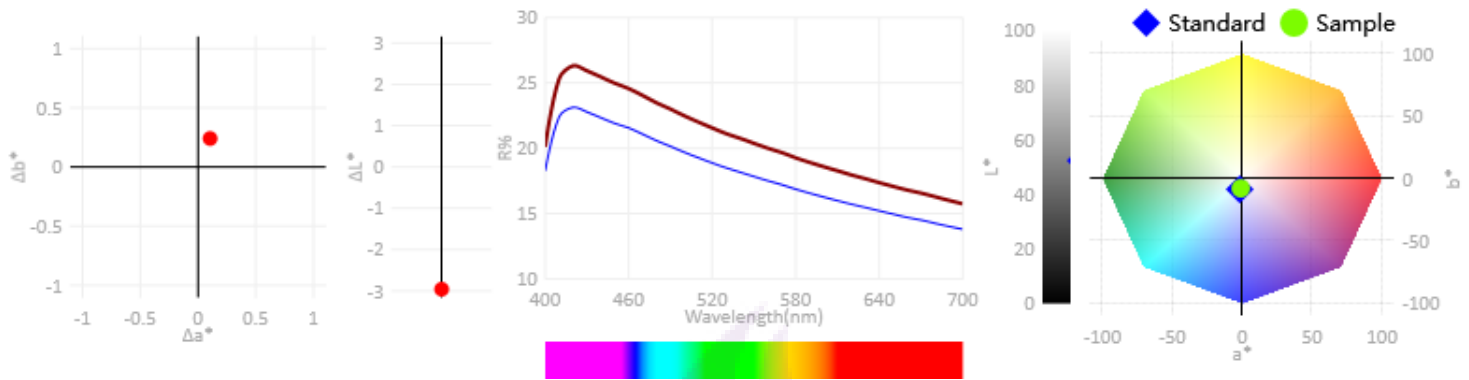

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	52.36	-1.68	-7.74	--	68.90
	Sample	49.40	-1.57	-7.50	121.10	74.67
A/2°	Standard	51.43	-3.89	-8.64	--	70.67
	Sample	48.51	-3.72	-8.35	121.10	76.45
F2/2°	Standard	51.70	-0.69	-9.03	--	70.17
	Sample	48.76	-0.64	-8.74	121.10	75.95

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-2.96	0.10	0.24	2.97	Fail
A/2°	-2.93	0.17	0.29	2.94	Fail
F2/2°	-2.94	0.06	0.29	2.95	Fail

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64