


# Color Difference Report

Specimen Information		
	Standard	Sample
Name	Prin***U	PCnoir®2429
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/7/2026 1:40:03 PM	4/7/2026 1:43:20 PM

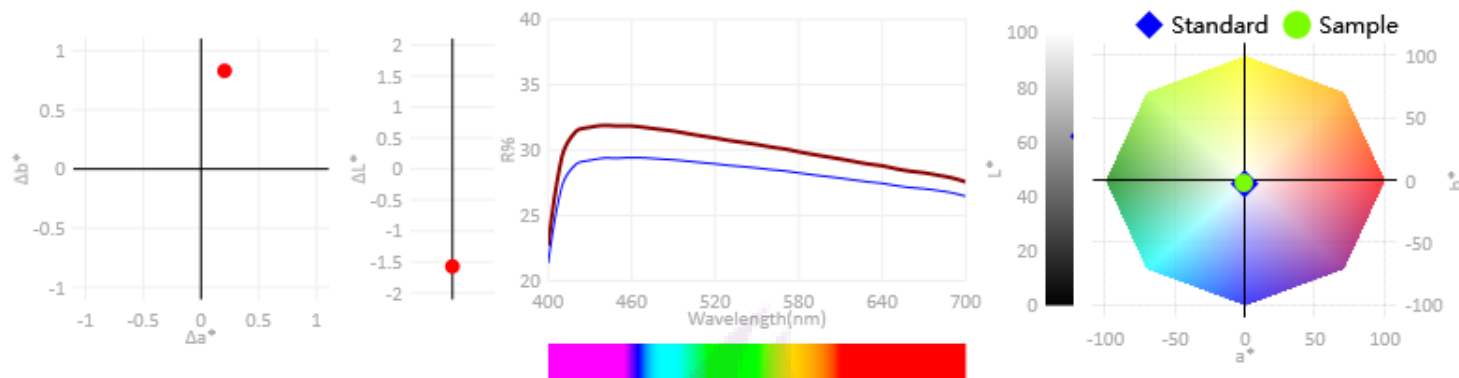

### Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

### Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	61.97	-1.19	-1.83	--	51.75
	Sample	60.40	-0.99	-1.00	111.61	54.41
A/2°	Standard	61.67	-1.65	-2.37	--	52.27
	Sample	60.19	-1.24	-1.44	111.61	54.77
F2/2°	Standard	61.78	-0.69	-2.25	--	52.08
	Sample	60.27	-0.60	-1.28	111.61	54.62

### Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.57	0.20	0.83	1.79	Fail
A/2°	-1.48	0.41	0.93	1.79	Fail
F2/2°	-1.50	0.09	0.97	1.79	Fail

Test: Alfred      Audit: Karry  
 Instrument Model: X-rite Ci64