


Color Difference Report

Specimen Information		
	Standard	Sample
Name	Prin***U	PCnoir@3800
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	4/7/2026 1:40:03 PM	4/7/2026 1:40:44 PM

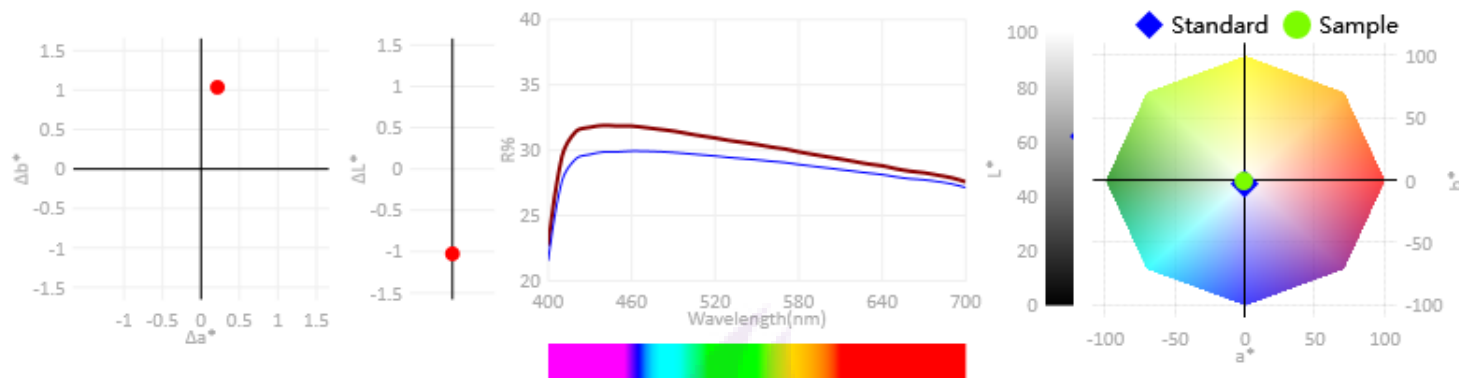

Tolerance

	ΔE*ab
D65/10°	1.000
A/2°	1.000
F2/2°	1.000

Color Indexes

		L*	a*	b*	Sum of K/S	MY Carbon
D65/10°	Standard	61.97	-1.19	-1.83	--	51.75
	Sample	60.95	-0.98	-0.79	107.59	53.48
A/2°	Standard	61.67	-1.65	-2.37	--	52.27
	Sample	60.76	-1.18	-1.23	107.59	53.80
F2/2°	Standard	61.78	-0.69	-2.25	--	52.08
	Sample	60.84	-0.60	-1.05	107.59	53.67

Color Diff.

	ΔL*	Δa*	Δb*	ΔE*ab	Judgement
D65/10°	-1.03	0.21	1.04	1.47	Fail
A/2°	-0.91	0.47	1.15	1.54	Fail
F2/2°	-0.94	0.08	1.20	1.53	Fail

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64