


Color Difference Report

Specimen Information		
	Standard	Sample
Name	PCnoir®AS	PCnoir®B
Material		
Condition	Φ4mm, SCE, UV Cut None	Φ4mm, SCE, UV Cut None
Date Time	3/31/2026 11:17:29 AM	3/31/2026 11:19:17 AM

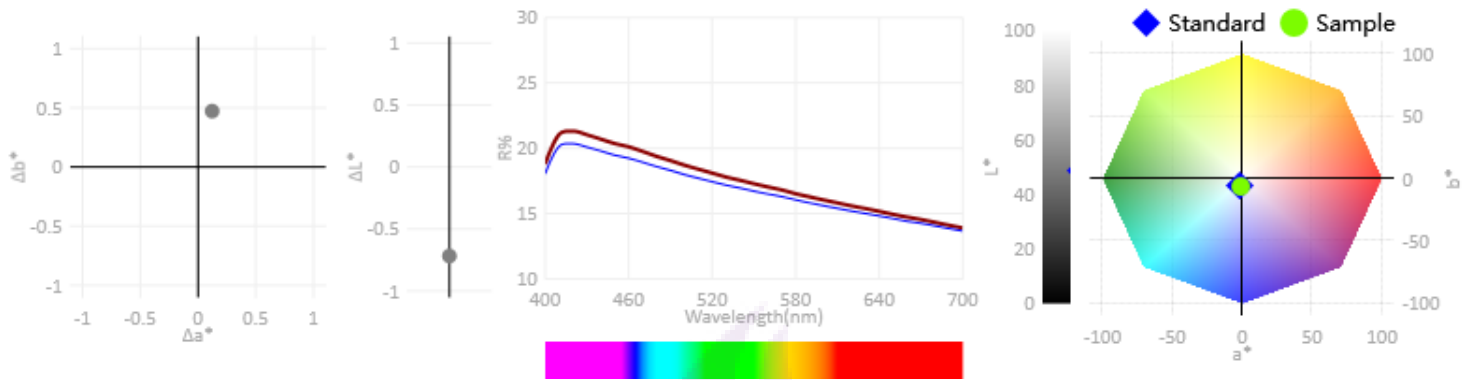

Tolerance

	D65/10°	A/2°	F2/2°
ΔE*ab	1.000	1.000	1.000

Color Indexes

	D65/10°		A/2°		F2/2°	
	Standard	Sample	Standard	Sample	Standard	Sample
L*	48.68	47.96	47.97	47.31	48.18	47.51
a*	-1.34	-1.22	-3.05	-2.79	-0.59	-0.53
b*	-5.96	-5.49	-6.62	-6.08	-6.92	-6.36
C*	6.11	5.62	7.29	6.69	6.94	6.39
h°	257.34	257.51	245.27	245.36	265.15	265.23
MY Carbon	76.10	77.56	77.54	78.89	77.12	78.49
Sum of K/S	--	104.54	--	104.54	--	104.54

Color Diff.

	D65/10°	A/2°	F2/2°
ΔL*	-0.72	-0.66	-0.67
Δa*	0.12	0.26	0.06
Δb*	0.47	0.54	0.55
ΔE*ab	0.87	0.89	0.87
Judgement	Pass	Pass	Pass

Test: Alfred Audit: Karry
 Instrument Model: X-rite Ci64